

Dupline® Cable Termination Unit Type DT 02



- Removes distortion caused by reflections
- For Dupline® High-Line only
- H1-housing
- For mounting on DIN-rail (EN 50022)
- No power supply needed

Product Description

Dupline® termination unit for removing distortion caused by reflections from the cable ends.

Ordering Key

DT 02

Type: Dupline® _____
Type no. _____

Type Selection

Ordering no.
Cable termination unit

DT 02

No code module required

Supply Specifications

Rated operational current Typ. 220 μ A
Power dissipation \leq 10 mW

General Specifications

Environment	
Degree of protection	IP 20
Pollution degree	3 (IEC 60664)
Operating temperature	-20° to +50°C (-4° to +122°F)
Storage temperature	-50° to +85°C (-58° to +185°F)
Humidity (non-condensing)	
0 to 80%	
Mechanical resistance	
Shock	15 G (11 ms)
Vibration	2 G (6 to 55 Hz)
Dimensions	
Material (see "Technical Information")	
H1-Housing	
Weight	
45 g	

Mode of Operation

When a generator connected to a non-terminated cable emits a square-wave signal, the cable ends will always cause reflections. Depending on distance and frequency, the signal can be distorted to a degree where the information becomes unreliable. However, these reflections can easily be removed by mounting the correct termination at the cable end.

In the case of Dupline® the critical distance between the generator and the far cable end is 2 km and above. Consequently, if as a rule of thumb a DT 02 termination unit is mounted at the cable end when the distance to the channel generator exceeds 1.2 km, reflections are avoided.


Note 1:
In case of branches on the cable it is only necessary to mount a second DT 02 if the distance to the nearest DT 02 exceeds 1.2 km. In all other cases a second DT 02 should not be mounted since it increases the capacity of the cable and thereby reduces the transmission distance.

Note 2:
The DT 02 is the only unit which can remove reflections and consequently cannot be replaced by other Dupline® modules.

Wiring Diagrams


Example 1

In this example the cable has two branches, and the distance from the channel generator to the cable ends exceeds 1.2 km. Consequently, a DT 02 must be mounted at both ends since no DT 02 is mounted within a distance of 1.2 km from the channel generator.

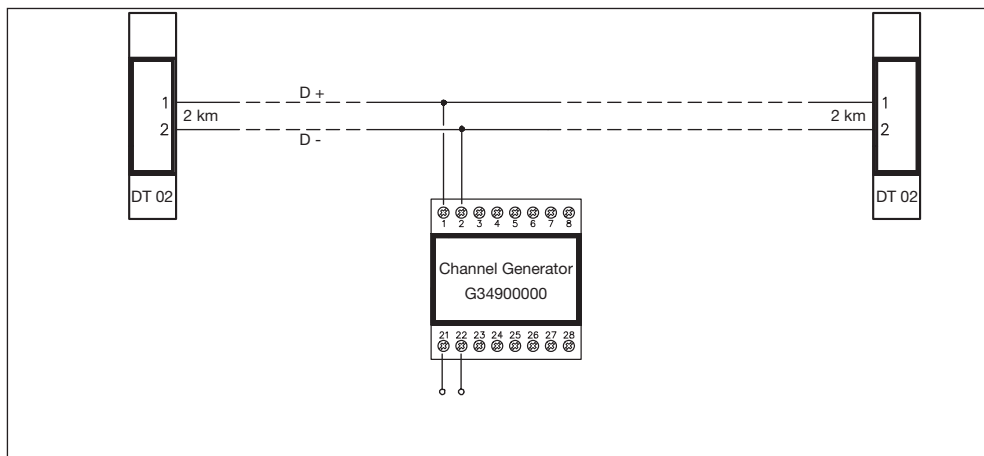

Example 2

In this example the cable also has two branches, and the distance from the channel generator to the far end of the cable exceeds 1.2 km. However, in this case it is not necessary to mount a DT 02 at point B, because the distance to the nearest DT 02 at point A is shorter than 1.2 km.

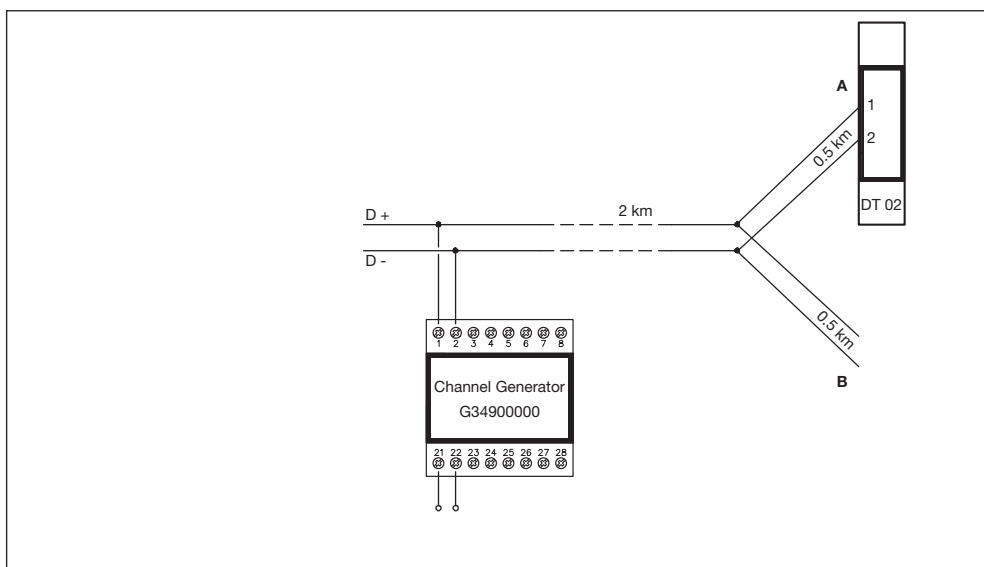

Dimensions (mm)

